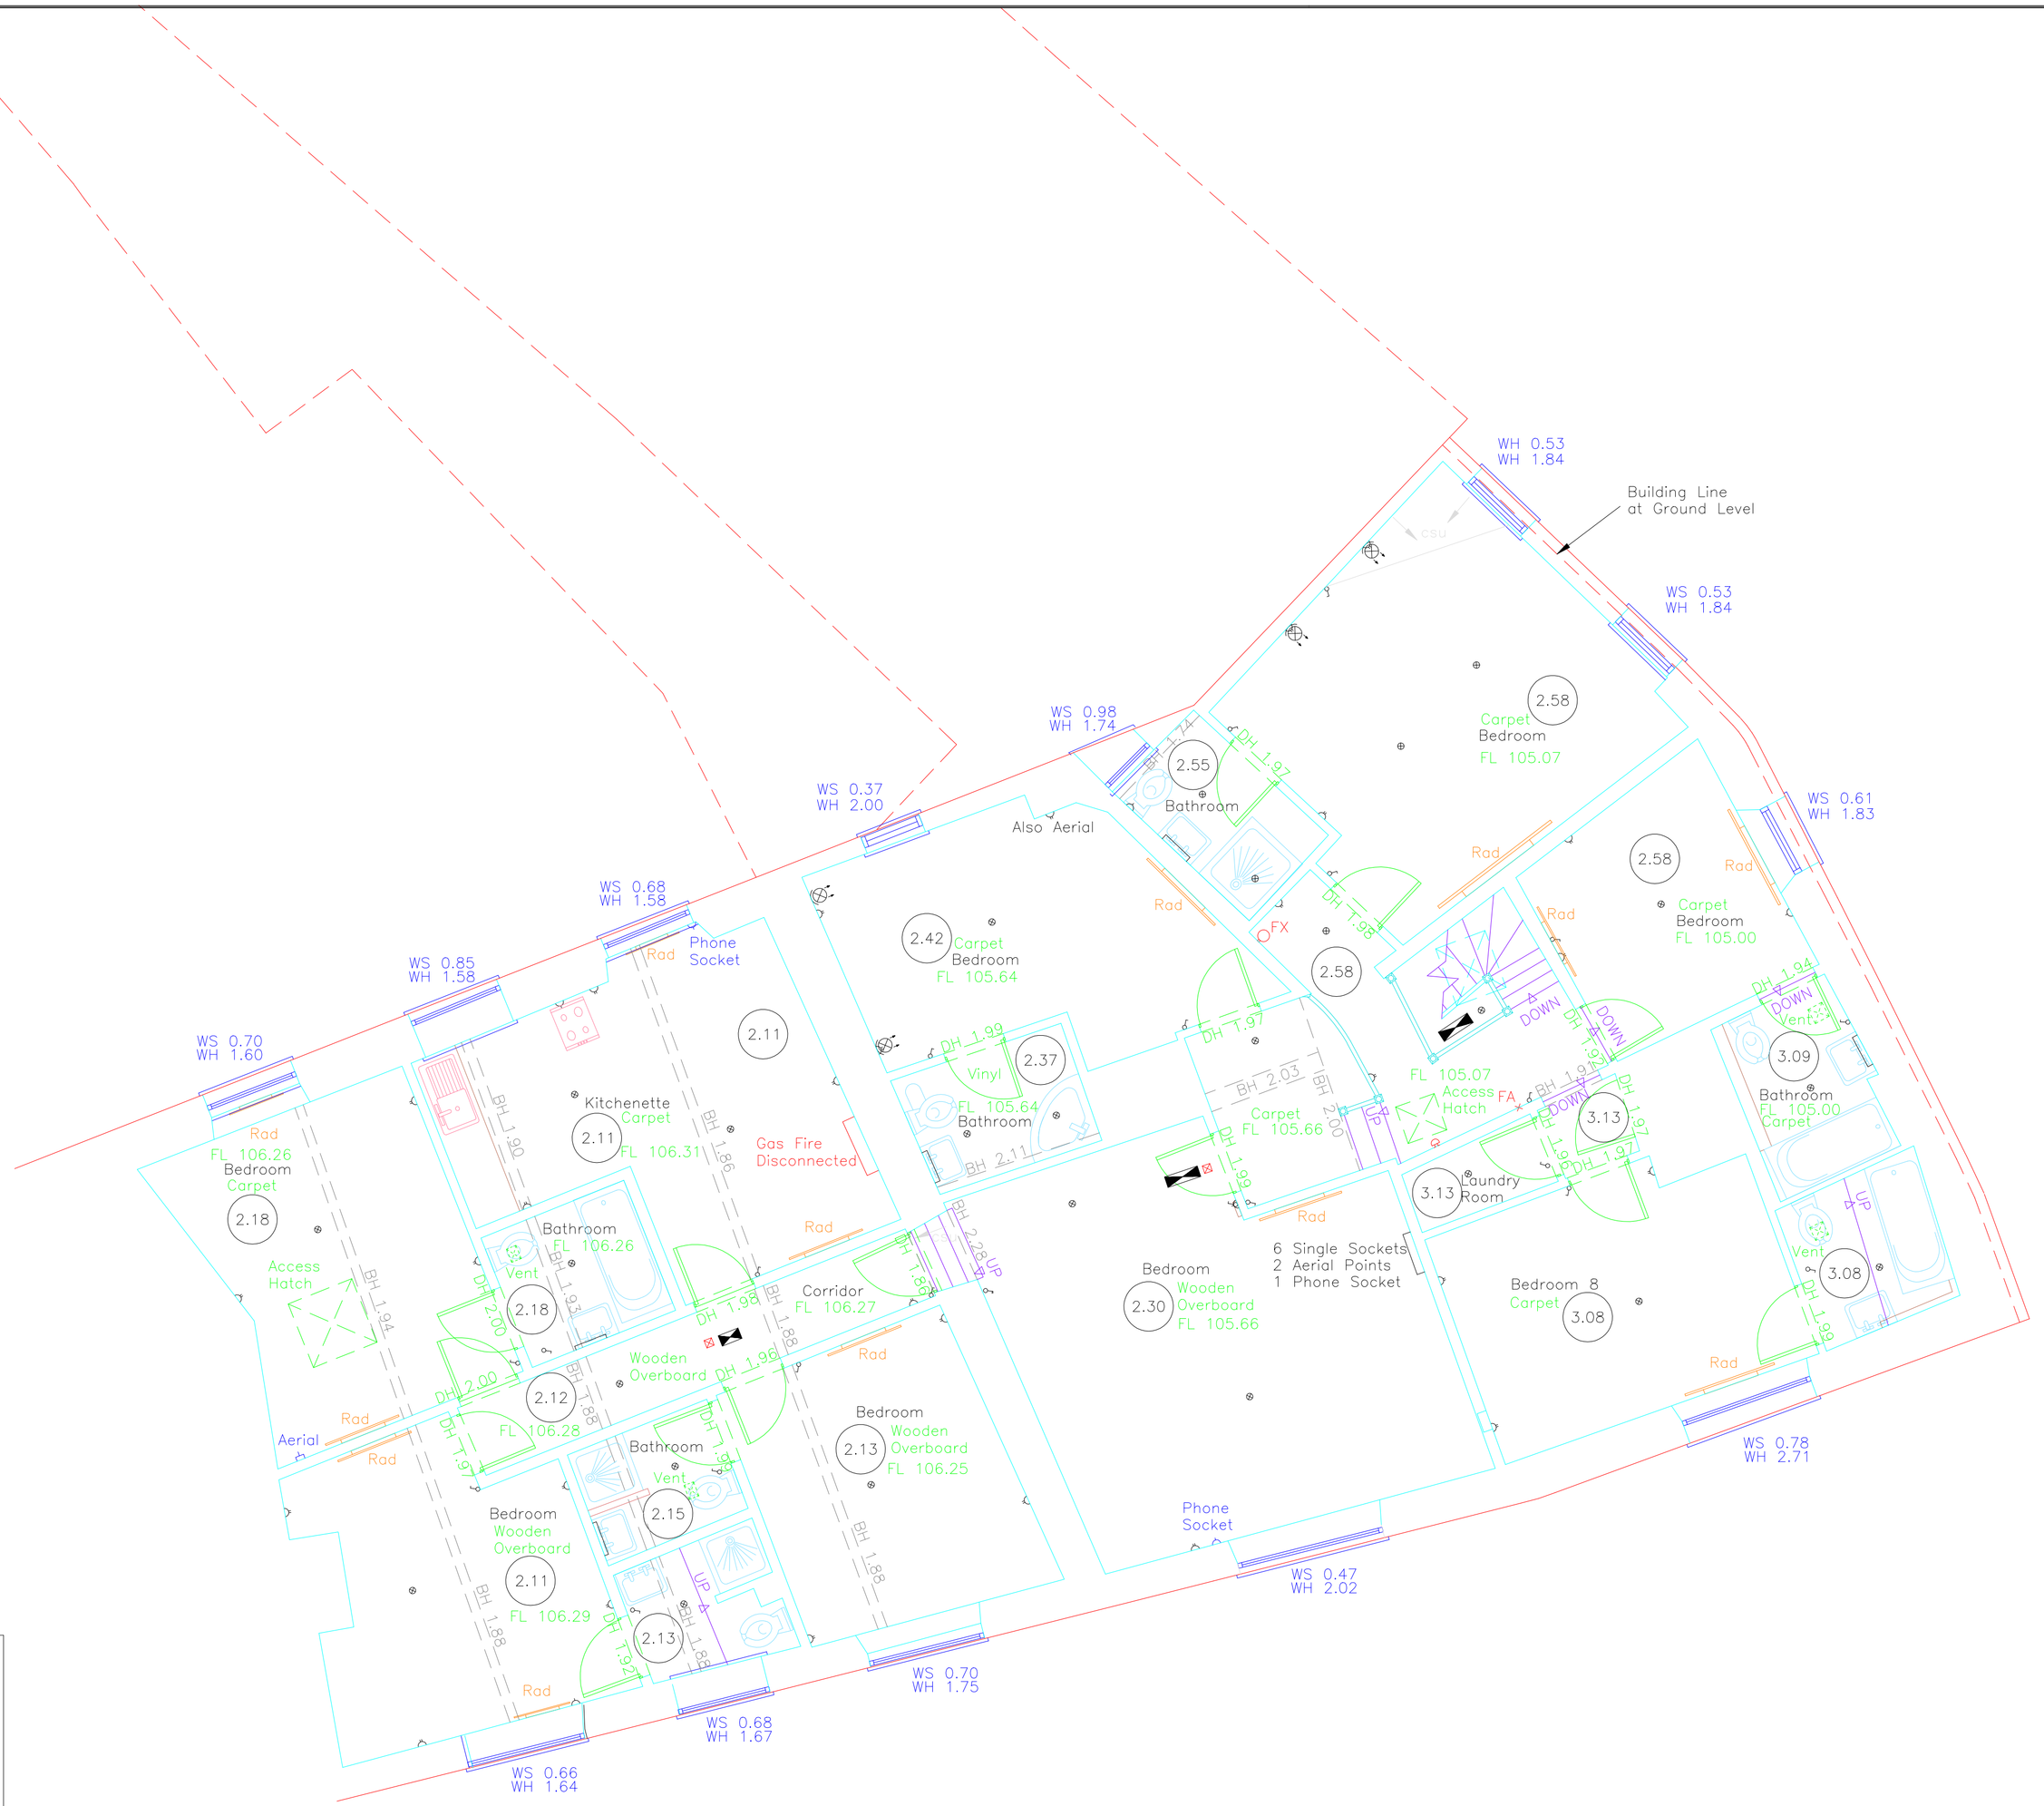

Plotted At Enlarged Scale of 1:50

FX	Fire Extinguisher
FA	Fire Alarm Call Point
	Smoke Detector
	Single Light Switch
	Double Light Switch
	Ceiling Light
	Wall Light
	Single Electricity Socket/Switch
	Double Electricity Socket/Switch
	Fuse Box
	Television Aerial Point
	Telephone Socket
	Light

NOTES

SERVICES
Services shown on this survey are from information on service enquiries and tracing with Electrolocation Equipment.
Some services may be undetectable, e.g. non-conductive pipes or cables, and therefore NOT SHOWN.

LEVEL INFORMATION

Heights in Metres
O.S.B.M. Location
Value

T.B.M. Location
Value

COORDINATE INFORMATION

Values in Metres
All Coordinates are based on an Arbitrary System

SURVEY STATION SCHEDULE

STN	TYPE	EASTINGS	NORTHINGS	LEVEL
ST01	HN	1000.000	5000.000	100.000
ST02	HN	991.402	5007.742	99.749
ST03	HN	983.657	5014.823	99.487
ST04	PKN	977.497	5023.969	99.289
ST05	PKN	994.746	5025.212	98.672
ST06	PKN	1020.589	5003.233	99.336
ST07	PKN	1013.875	5003.233	99.336

ABBREVIATIONS

General

(A)	Approximate	LB	Letter Box
Ave	Average	Ld	Ladder
(AR)	Assumed Route	LP	Lamp Post
B	Bollard	M	Meter
BB	Bottom Bank	MH	Manhole
BBn	Belisha Beacon	MK	Marker
BIN	Litter Bin	Mon	Monument
Bldg	Building	NB	Notice Board
BLW	Block Retaining Wall	NFI	No Further Information
BRW	Brick Retaining Wall	o/h	Overhead
BS	Bus Stop	o/l	Outline of
BTIC	British Telecom Inspection Chamber	OSBM	Ordnance Survey Bench Mark
BTJB	British Telecom Junction Box	OT	Oil Trap
BW	Brick wall	PC	Point
CE	Cable TV Entry Point	PGM	Permanent Ground Marker
CEK	Concrete Edging Kerb	PI	Petrol Interceptor
CIG	Cable Into Ground	PIG	Pipe Into Ground
CL	Cover Level	PKN	Parker Kalon Nail
CM	Cable Marker	PL1	Pavement Light
Col	Column	PM	Parking Meter
conc	Concrete	PN	Pipe Nail
CP	Concrete Post	PNI	Pipes Not Identifiable
CPS	Concrete Paving Slabs	RD	Records
CRW	Concrete Retaining wall	RE	Rodding Eye
CS	Concrete Steps	RGL	Ridge Level
CT	Cable TV IC	RL	Roof Level
CW	Concrete wall	RS	Road Sign
D	Duct	RSJ	Rolled Steel Joist
d	Depth	RW	Retaining Wall
DF	Drinking Fountain	RWC	Rain Water Channel
Dia	Diameter	RWP	Rain Water Pipe
DJ	Dilapidated	SA	Soakaway
DK	Drop kerb	SB	Sign Board
DM	Duct Marker	SBM	Site Bench Mark
DP	Post	SD	Slot Drain
DP	Down Pipe	SEK	Stone Edging Kerb
E	Earth	Shb	Shrub Bed
EC	Electricity Cable Outlet	SL	Sump Level
EJB	Electricity Junction Box	SRW	Stone Retaining Wall
EL	Eaves Level	St	Stanchion
ELC	Electricity Inspection Chamber	Sub	Substation
EM	Electricity Meter	SV	Stop Valve
EP	Electricity Pole	SVK	Stop Valve Marker
EO	Electricity Wires Overhead	SVP	Soil Vent Pipe
ER	Earthing Rod	SW	Stone Wall
(ET)	Electronically Traced	SWIC	Storm Water Inspection Chamber
FB	Footbridge	ST	Step
FD	French Drain	SY	Stay
FEsc	Fire Escape	Tac	Tactile Paving
FL	Floor Level	Tar	Tarmac
FLB	Flower Bed	TB	Top of Bank
FP	Footpath	TCB	Telephone Call Box
FS	Flood Sensor	TL	Threshold Level
FH	Fire Hydrant	TL1	Traffic Light
FHMK	Fire Hydrant Marker	TO	Telephone Wire Overhead
Fhs	Fire Hose	TP	Telephone pole
FIG	Feeds Into Ground	TPS	Textured Paving Slabs
FWIC	Foul Water Inspection Chamber	TS	Tree Stump
g	Girth	u/g	Underground
Gbn	Gabions	Up	Up
GAS	Gas Outlet Pipe	UR	Unable To Lift
GM	Gas Meter	UT1	Unable To Trace
GMK	Gas Meter Marker	UTTF	Unable To Trace Further
Gr	Grass	Vep	Vent Pipe
GT	Grease Trap	VP	Vent Pipe
Gvl	Gravel	VSP	Vent Soil Pipe
GV	Gas Valve	VT	Vent
GVK	Gas Valve Marker	w	Width
GY	Gully	WC	Water Closet
H	Height	WL	Water Level
Hc	Hardcore	WM	Water Meter
HN	Hilti Nail	WMK	Water Meter Marker
IC	Inspection Cover	WO	Wash Out
ICh	Inspection Chamber	WP	Wooden Peg
IL	Invert Level	WT	Water Tap
K	Kerb	WV	Water Valve
KO	Kerb Outlet		

Fences

At	Angle Iron	I/WF	InterWoven Fence
Bar	Barrier	MP	Metal Post
B/WF	Barbed Wire Fence	MPR	Metal Post & Rail Fence
CB	Crash Barrier	O/BF	Open Boarded fence
C/BF	Close Boarded Fence	P	Pillar or Post
CnP	Chestnut Paling	PM	Pig Mesh
C/IF	Corrugated Iron Fence	RF	Railed Fence
C/LF	Chain Link Fence	Temp	Temporary Fencing
CP	Concrete Post	W	Wall
C/PF	Chestnut Paling Fence	WF	Wire Fence
GP	Gate Post	WG	Wooden Gate
GR	Guard Rail	W/MF	Wire Mesh Fence
I/WF	Iron Railed Fence	WP	Wooden Post
		WPR	Wooden Post & Rail Fence

Measured Building Survey

AB	Airbrick	LC	Lightning Conductor
AH	Arch Head Height	Rad	Radiator
AVt	Air Vent	Sc	Socket
BH	Beam Soffit Height	Sc	Square Column
BSL	Beam Soffit Level	SKL	Skylight
Chy	Chimney	SL	Soffit Level
csu	Ceiling Slopes Upwards	WAH	Window Arch Height
Cup'd	Cupboard	WB	Wash Basin
DH	Door Height	WH	Window Head Height
DS	Door Sill	WHL	Window Head Level
FA	Fire Alarm	WS	Window Sill
H	Header	WSL	Window Sill Level
L	Light	WSP	Window Spring Point
(2.80)	Ceiling Height (false)	(2.60)	Ceiling Height (true)

Rev.	Date	Amendments

LEWIS BROWN
CHARTERED LAND SURVEYORS
RICS
Quattro House
Castle Road
Chelston Business Park
Wellington
TA21 9JQ
Tel. 01823 667200
Fax. 01823 663266
www.lewisbrown.co.uk
Email. survey@lewisbrown.co.uk
Lewis Brown Limited Registered in England No. 4193534

CLIENT:
PLUMTREEMEE LTD

THE OLD SCHOOL HOUSE
ST. JOSEPH'S ROAD
TADCASTER

TITLE:
SECOND FLOOR MEASURED BUILDING SURVEY
AT THE WHITE HART HOTEL

THE WHITE HART HOTEL
WILVELISCOMBE
SOMERSET

Drawing Number:		Revision:
K04188_SF_SX		
Scale:	Survey Date:	Sheet:
1:100	09:04	4 of 5
Drawn:	Checked:	
JWH	DIL	